


REQUIRED WHEN A SEPARATE TRENCH OR A
10' MINIMUM SEPARATION IS NOT POSSIBLE

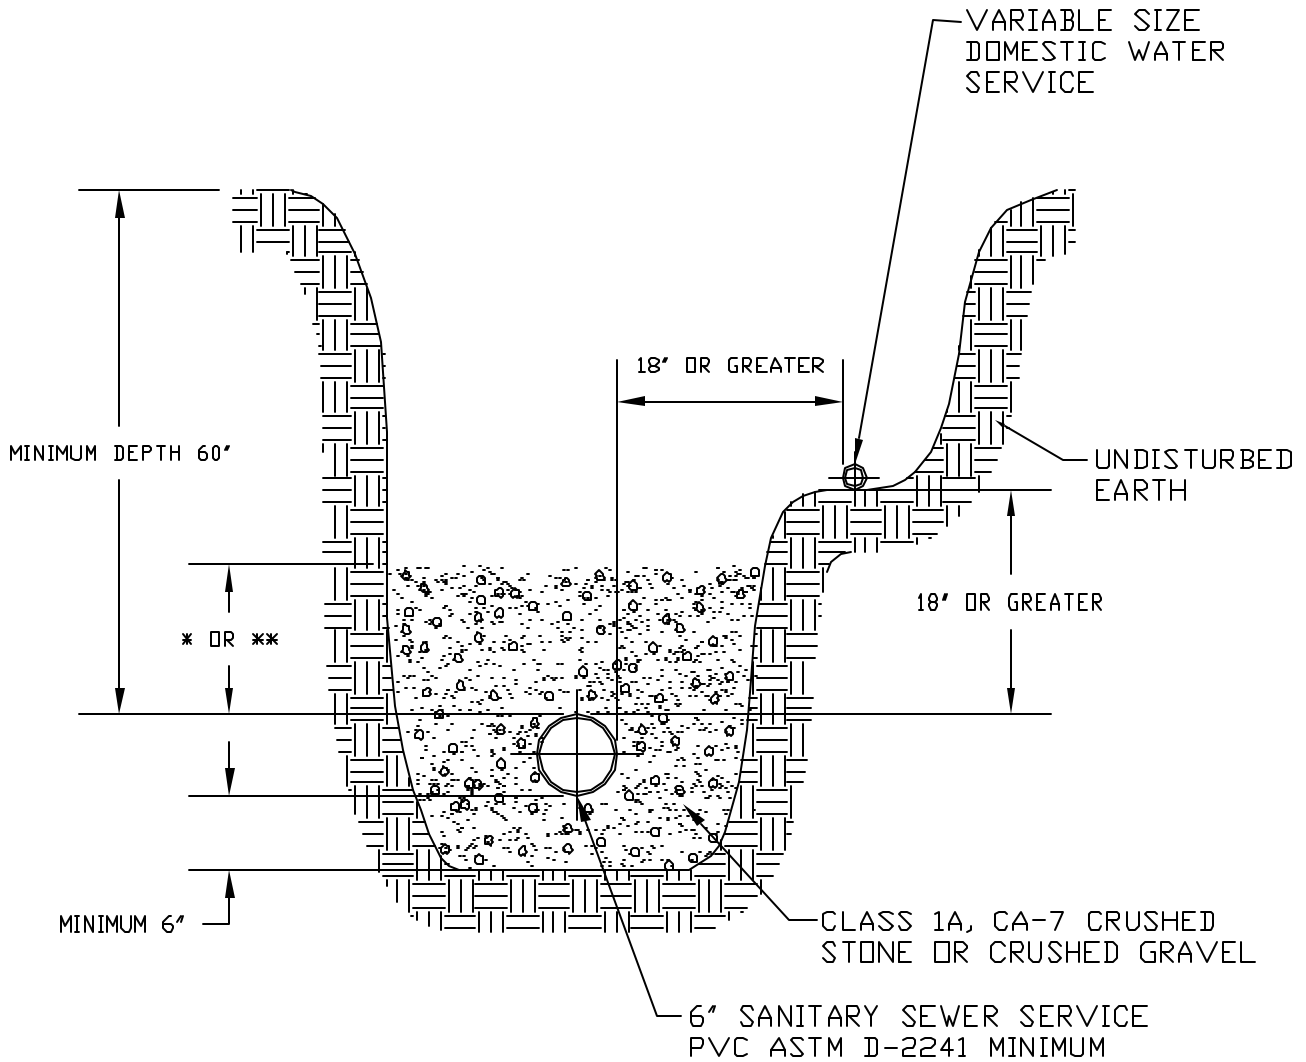

* 4" MIN. FOR RIGID PIPE INSTALLATION

** 12" MIN. FOR FLEXIBLE PIPE INSTALLATION

**YORKVILLE-BRISTOL
SANITARY DISTRICT**

SANITARY SEWER SERVICE & POTABLE
WATER SERVICE SEPARATION

DESIGNED JWF	APPROVED PFM	SCALE NTS
DRAWN	DATE 10/9/06	STD-010